Engineering Data

Thermal Efficiency Curve

Endura+ Condensing Hydronic Boilers
Model: EDR+6000

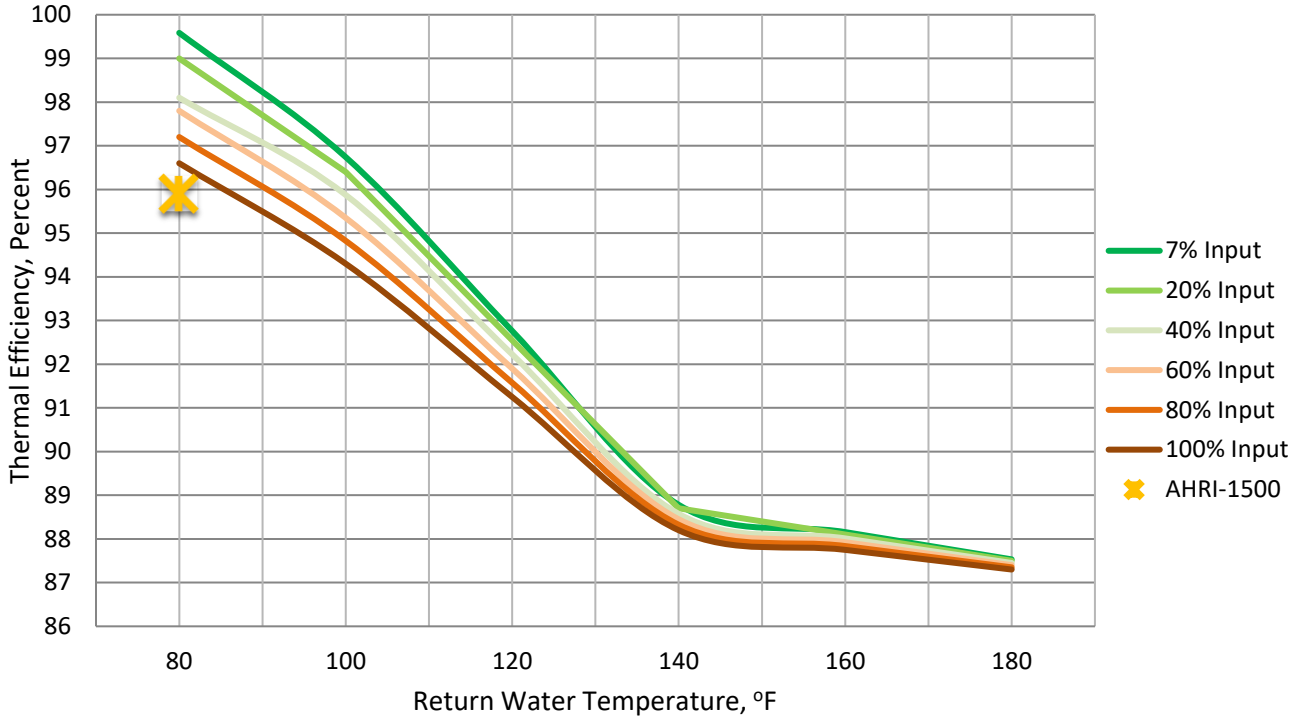

Notes:

1. Fuel is standard natural gas.
2. Data collected at the Fulton R&D Laboratory in Pulaski, NY.
3. Thermal efficiency curves obtained using a 20°F differential temperature and modified methodology from the AHRI-1500 test procedures.

Fulton Heating Solutions, Inc.
6288 Running Ridge Rd., Syracuse, NY 13212
Phone: (315) 298-8510 • Fax: (315) 396-0334