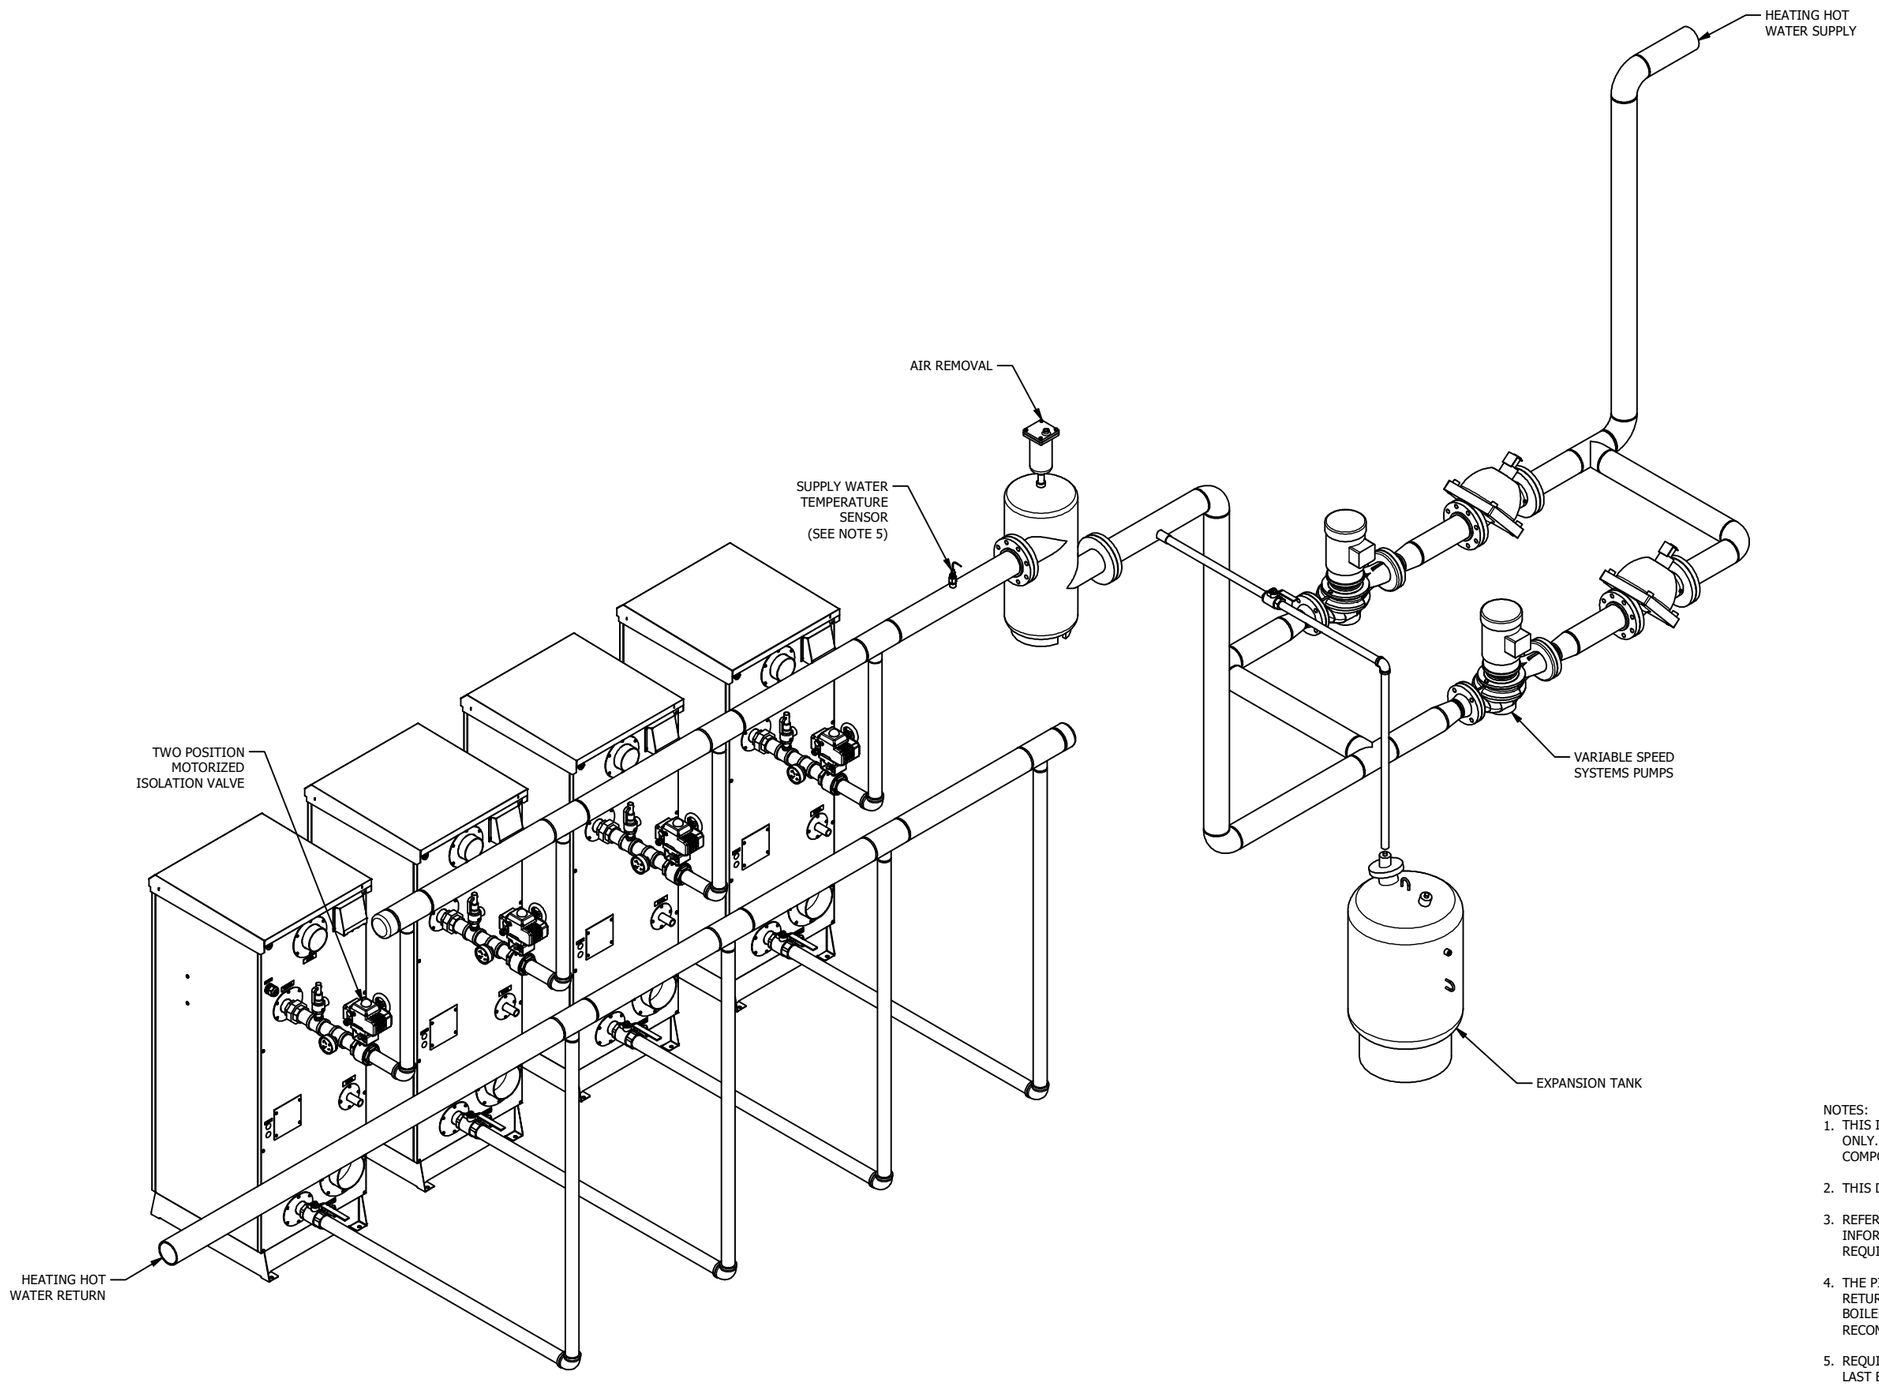


NOTES:
1. THIS IS A TYPICAL ARRANGMENT FOR REFERENCE PURPOSES ONLY. ACTUAL INSTALLATIONS MAY REQUIRE ADDITIONAL COMPONENTS WHICH ARE NOT SHOWN FOR CLARITY.
2. THIS DRAWING IS NOT FOR CONSTRUCTION PURPOSES.
3. REFER TO THE INSTALLATION AND OPERATION MANUALS FOR INFORMATION REGARDING CLEARANCES AND INSTALLATION REQUIREMENTS.
4. THE PIPING CONFIGURATION SHOULD UTILIZE A REVERSE RETURN HEADER TO PROPERLY BALABNCE FLOW ACROSS THE BOILERS. WHERE REVERSE RETURN CANNOT BE USED, IT IS RECOMMENDED TO INSTALL A BALANCING VALVE PER BOILER.
5. REQUIRED FOR LEAD/LAG. INSTALL DOWNSTREAM OF THE LAST BOILER.

| REV | REVISION DESCRIPTION | CHECKED BY | B.O.M. / PLANT | MECH. / ELEC. | ASME | APPROVED BY |
|---|---|---|---|---|---|---|
| - | INITIAL RELEASE | - | - | - | - | - |

REVISION HISTORY

UNLESS OTHERWISE NOTED DIMENSIONS ARE DUAL DIMENSIONED

| TOLERANCES | INCH | METRIC |
|---|---|---|
| FRACTION & WHOLE VALUE | ± 1/8 | ± 3mm |
| (1) PLACE DEC. | ± 0.03 | ± 0.7mm |
| (2) PLACE DEC. | ± 0.015 | ± 0.38mm |
| (3) PLACE DEC. | ± 0.005 | ± 0.12mm |
| ANGLE | ± 0.5DEG | ± 0.5 DEG |
| SURFACE FINISH | 250 MICRO-INCHES | SURFACE FINISH 6.35 MICRO-METERS |

This design and drawings are proprietary and are the exclusive property of The Fulton Companies. The corporation does not permit their use except with prior written consent.

The items shown in this drawing may be covered by one or more patents of The Fulton Companies.

THIRD ANGLE PROJECTION

| | | | |
|---|---|---|---|
| DRAWN BY: T. BETTS | 3/25/2021 | MECHANICAL / ELECTRICAL REVIEW: ARP | 3/29/2021 |
| CHECKED BY: N/A | | ASME REVIEW: N/A | |
| B.O.M. / PLANT REVIEW: N/A | | APPROVED BY: KDB | 3/29/2021 |

JOB NUMBER:

PROJECT NAME:

PROJECT MANAGER:

DESCRIPTION:
# ENDURA XE BOILER PRIMARY ONLY VARIABLE FLOW MODULAR PLANT PIPING DIAGRAM

SHEET 1 OF 1

Fulton
Fulton Heating Solutions, Inc.

DRAWING NUMBER: G-37-100004

REVISION: -