CUSTOMER CONNECTIONS			
ITEM	DESCRIPTION	SIZE	TYPE
A	HOT WATER OUTLET	2.5"	150#
B	HOT WATER INLET	2.5"	150#
C	BLOWDOWN OUTLET	1.5"	N.P.T.
D	EXHAUST STACK	8"	- - -
E	SAFETY RELIEF VALVE	APPLICATION SPECIFIC	N.P.T.
F	FUEL INLET	APPLICATION SPECIFIC	N.P.T.
G	WATER COLUMN DRAIN	1"	N.P.T.

EQUIPMENT SPECIFICATION CHART	
BOILER INPUT:	1750000 BTU/HR
BOILER OUTPUT:	1488000 BTU/HR
APPX. BOILER HP:	44.5 HP
APPX. SHIPPING WEIGHT:	3800 LBS
APPX. OPERATING WEIGHT:	4380 LBS
WATER CAPACITY (FLOODED):	70 GAL.
MAX. OPERATING TEMPERATURE:	230°F

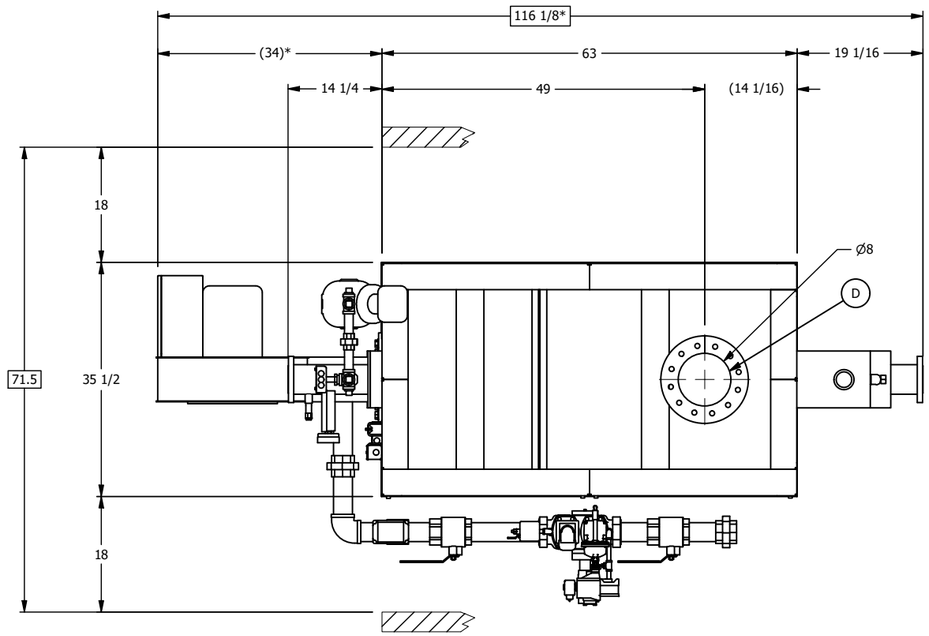

TOP VIEW

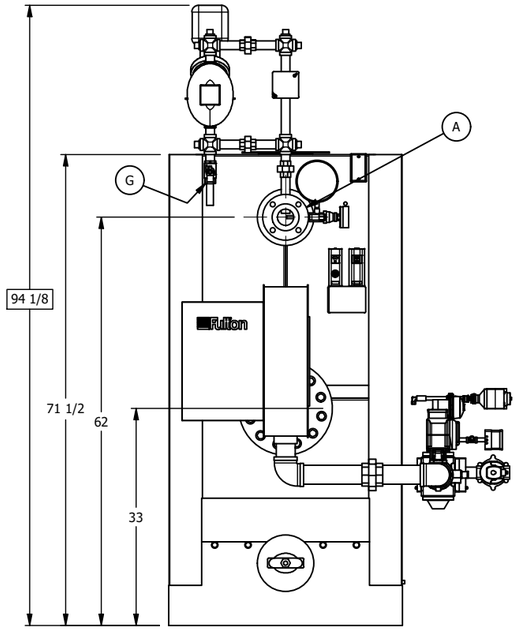

FRONT VIEW

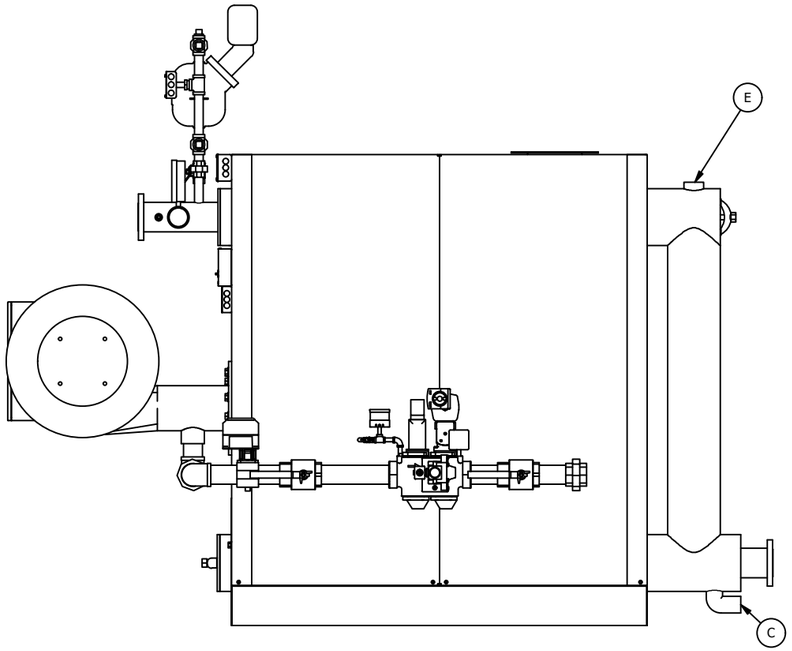

SIDE VIEW

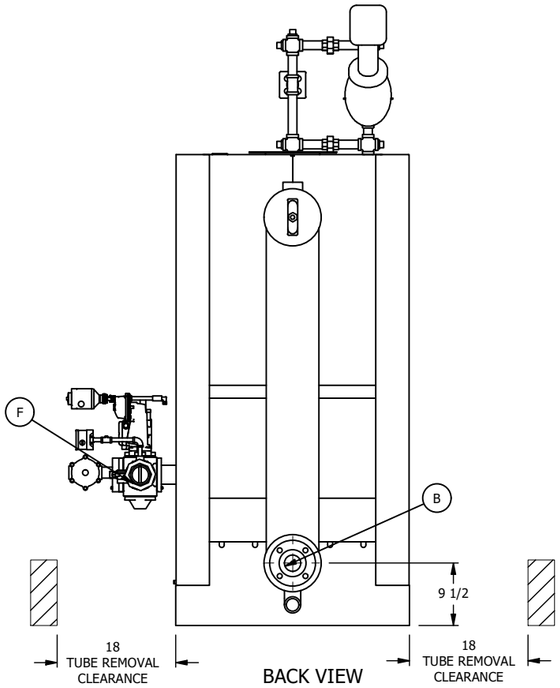

BACK VIEW

NOTES:

1. ALL CLEARANCES ARE FACTORY RECOMMENDATIONS. CONSULT LOCAL JURISDICTION FOR EXACT CODE COMPLIANCE.
2. FULTON RECOMMENDS 36" IN FRONT OF ELECTRICAL PANELS, 18" CLEARANCE BETWEEN INSPECTION OPENINGS OF ALL BOILERS, 18" CLEARANCE OF HANDHOLES, 14" FROM EXHAUST STACK, AND 18" FOR TUBE REMOVAL CLEARANCE.
3. PLEASE REFER TO THE O&M MANUAL FOR ADDITIONAL INFORMATION REGARDING CLEARANCES AND INSTALLATION INSTRUCTIONS.
4. ALL DIMENSIONS INSIDE ( ) DENOTE REFERENCE DIMENSIONS.
5. ALL DIMENSIONS INSIDE □ DENOTE OVERALL DIMENSIONS.
6. WE RESERVE THE RIGHT TO CHANGE SPECIFICATIONS AND/OR DIMENSIONS. ALL INFORMATION IS SUBJECT TO CHANGE BASED ON ADDITION OF ANY OPTIONAL EQUIPMENT AND/OR ACCESSORIES. PLEASE CONSULT THE FACTORY FOR PROJECT SPECIFIC ESTIMATES IF ADDITIONAL OPTIONS OR ACCESSORIES ARE REQUIRED.
7. *OVERALL SIZE, CONNECTION SIZES, OR CONNECTION LOCATION MAY VARY BASED ON APPLICATION. CONTACT FACTORY FOR ADDITIONAL INFORMATION.

REV	REVISION DESCRIPTION	CHECKED	BOM/PLANT	MECH/ELEC	ASME	APPROVED
A	UPDATED FLANGE CLASS K.J.K - 6/23/23	-	-	-	-	T.K. 6/23/23

REVISION HISTORY

UNLESS OTHERWISE NOTED DIMENSIONS ARE DUAL DIMENSIONED

TOLERANCES	INCH	METRIC
FRACTION & WHOLE VALUE	± 1/8	± 3mm
(1) PLACE DEC.	± 0.03	± 0.7mm
(2) PLACE DEC.	± 0.015	± 0.38mm
(3) PLACE DEC.	± 0.005	± 0.12mm
ANGLE	± 0.5DEG	± 0.5 DEG

SURFACE FINISH 250 MICRO-INCHES — SURFACE FINISH 6.35 MICRO-METERS

This design and drawings are proprietary and are the exclusive property of The Fulton Companies. The corporation does not permit their use except with prior written consent.

The items shown in this drawing may be covered by one or more patents of The Fulton Companies.

THIRD ANGLE PROJECTION

DRAWN BY: T. KENNEDY	3/30/2022	MECHANICAL / ELECTRICAL REVIEW: N/A		JOB NUMBER:	
CHECKED BY: N/A		ASME REVIEW: N/A		PROJECT NAME:	
B.O.M. / PLANT REVIEW: N/A		APPROVED BY: E.B.W	4/7/2022	PROJECT MANAGER:	

DESCRIPTION: FB-0150-X-HW FLEXIBLE WATERTUBE HOT WATER BOILER (44.5HP)

SHEET 1 OF 1

Fulton

DRAWING NUMBER: FB-0150-X-HW

REVISION: A